

CURVES C900 R7

Lineshaft Turbine Pump Curves

900 RPM CURVES - 60 CYCLE PERFORMANCE

INDEX - 60 CYCLE PERFORMANCE - 900 RPM


Page	Model	RPM	Date Issued
<u>4</u>	8RJLC	885	July 17, 2019
<u>5</u>	10MO	885	July 17, 2019
<u>6</u>	10RJHC	885	January 11, 2022
7	10RJLC	885	December 18, 2019
8	12MLO	885	July 17, 2019
9	12MMO	885	July 17, 2019
<u>10</u>	18DXC	885	July 17, 2019
<u>11</u>	18GHXC	885	December 18, 2019
12	20EHC	885	July 17, 2019
<u>13</u>	20EHXC	885	April 18, 2023
<u>14</u>	20ELC	885	July 17, 2019
<u>15</u>	20GHC	885	December 18, 2019
<u>16</u>	20GHXC	885	May 9, 2024
<u>17</u>	20GLC	885	July 17, 2019
<u>18</u>	20GLXC	885	July 17, 2019
<u>19</u>	20RCHC	885	July 17, 2019
<u>20</u>	20RCLC	885	July 17, 2019
<u>21</u>	24CHC	885	July 17, 2019
22	24CLC	885	July 17, 2019
<u>23</u>	24DMC	885	July 17, 2019
<u>24</u>	24DXC	885	July 17, 2019
<u>25</u>	24EHC	885	July 17, 2019
<u>26</u>	24ELC	885	July 17, 2019
27	24FHC	885	July 17, 2019
<u>28</u>	24GHC	885	July 17, 2019
<u>29</u>	24GHXC	885	July 17, 2019
<u>30</u>	24GLC	885	July 17, 2019
<u>31</u>	26GHC	885	July 17, 2019
<u>32</u>	26GHXC	885	July 17, 2019
<u>33</u>	28BHC	885	July 17, 2019
<u>34</u>	28BLC	885	July 17, 2019
<u>35</u>	28GHC	885	July 17, 2019
<u>36</u>	28GHXC	885	July 17, 2019
<u>37</u>	30BHC	885	July 17, 2019
<u>38</u>	30BLC	885	July 17, 2019

Goulds Water Technology

Turbine

INDEX - 60 CYCLE PERFORMANCE - 900 RPM

Page	Model	RPM	Date Issued
<u>39</u>	30GHC	885	November 04,2019
<u>40</u>	30GHXC	885	November 04,2019
<u>41</u>	30GLC	885	November 04,2019
<u>42</u>	32GHC	885	November 04,2019
<u>43</u>	32GHXC	885	November 04,2019
<u>44</u>	32GLC	885	November 04,2019
<u>45</u>	34GHC	885	November 04,2019
<u>46</u>	34GHXC	885	November 04,2019
<u>47</u>	34GLC	885	November 04,2019
<u>48</u>	36GHC	885	November 04,2019
<u>49</u>	36GHXC	885	November 04,2019
<u>50</u>	36GLC	885	November 04,2019

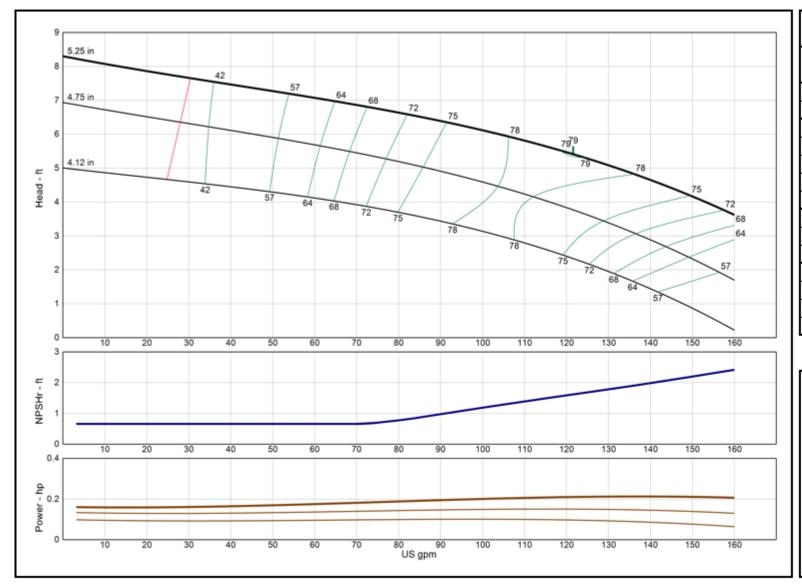


Model	8RJLC	
RPM	885	
Freq Poles	60 Hz 8-pole	
Pump Type	Lineshaft	
EFFICIENCY	CORRECTION	
1-STAGE	0.0	
2-STAGE	0.0	
3-STAGE	0.0	
4-STAGE	0.0	
Impeller Type	Enclosed	
Ns	2750	
Thrust K-Factor	4.00 lb/ft	
Bowl OD	7.50 in	
Bowl Lateral	0.62 in	
Max PSI	410 psi	
Thd Disch Size	4", 5", 6"	
TURRING ORGANIONS		

Lubbock, Texas







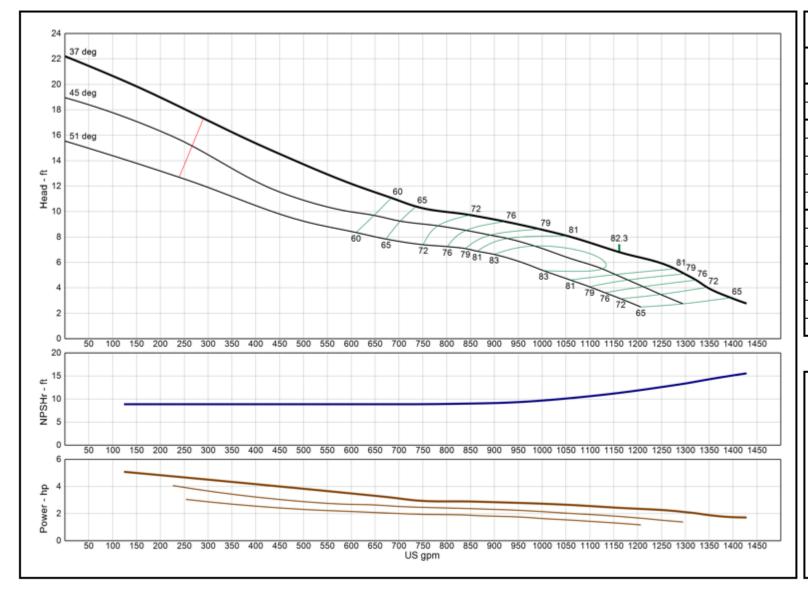

Model	10MMO
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Open
Ns	7120
Thrust K-Factor	0.00 lb/ft
Bowl OD	0.00 in
Bowl Lateral	0.00 in
Max PSI	370 psi
Thd Disch Size	10", 12"

TURBINE OPERATIONS

Lubbock, Texas








MODEL 10RJHC

(Effective January 11, 2022)

Vertical Turbine Pump

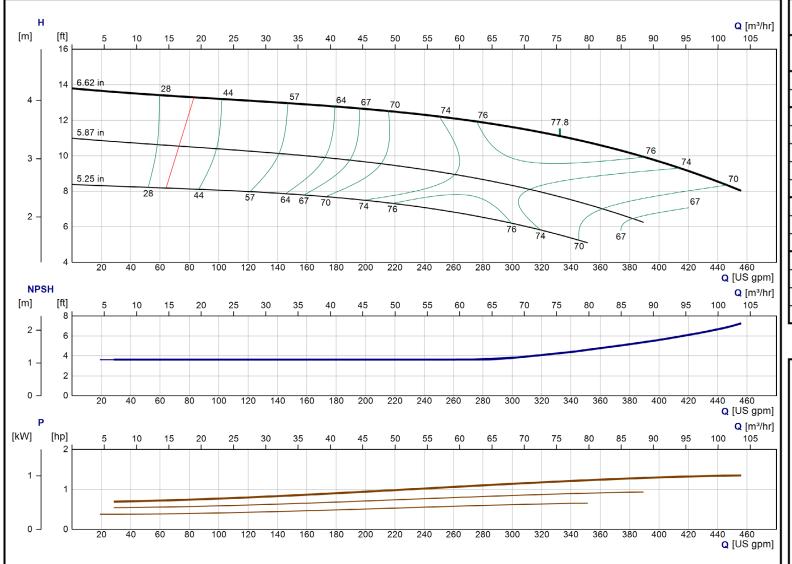

Model	10RJHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY CORRECTION	
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2780
Thrust K-Factor 7.00 lb/ft	
Bowl OD	9.50 in
Bowl Lateral	0.75 in
Max PSI	370 psi
Thd Disch Size	4", 5", 6", 8"
TURRING ORGRATIONS	


TURBINE OPERATIONS

Lubbock, Texas







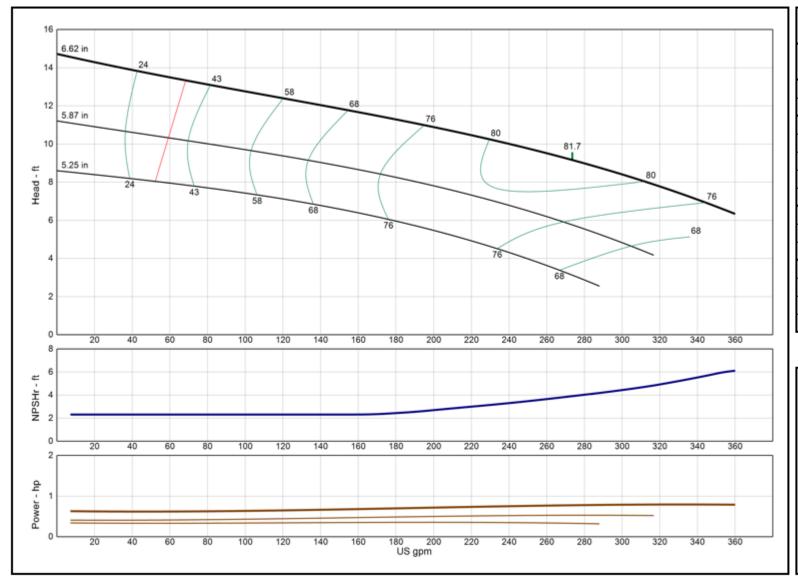

Model	10RJLC	
RPM	885	
Freq Poles	60 Hz 8-pole	
Pump Type	Lineshaft	
EFFICIENCY	CORRECTION	
1-STAGE	0.0	
2-STAGE	0.0	
3-STAGE	0.0	
4-STAGE	0.0	
Impeller Type	Enclosed	
Ns	2780	
Thrust K-Factor	7.00 lb/ft	
Bowl OD	9.50 in	
Bowl Lateral	0.75 in	
Max PSI	370 psi	
Thd Disch Size	4", 5", 6", 8"	
TURRING ORGANIONS		


TURBINE OPERATIONS

Lubbock, Texas







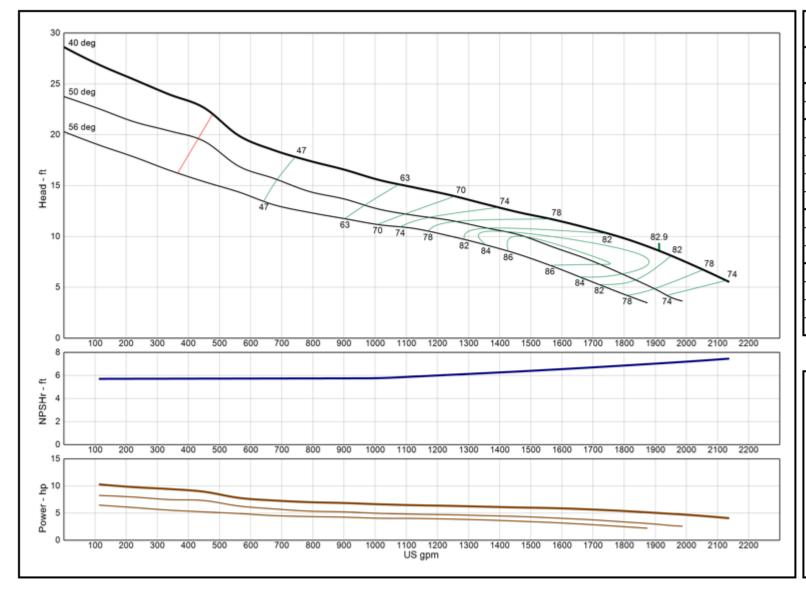


Model	12MLO	
RPM	885	
Freq Poles	60 Hz 8-pole	
Pump Type	Lineshaft	
EFFICIENCY	CORRECTION	
1-STAGE	0.0	
2-STAGE	0.0	
3-STAGE	0.0	
4-STAGE	0.0	
Impeller Type	Open	
Ns	7710	
Thrust K-Factor	31.50 lb/ft	
Bowl OD	0.00 in	
Bowl Lateral	0.00 in	
Max PSI	340 psi	
Thd Disch Size	12", 14"	
TURRING ORGANIONS		

Lubbock, Texas







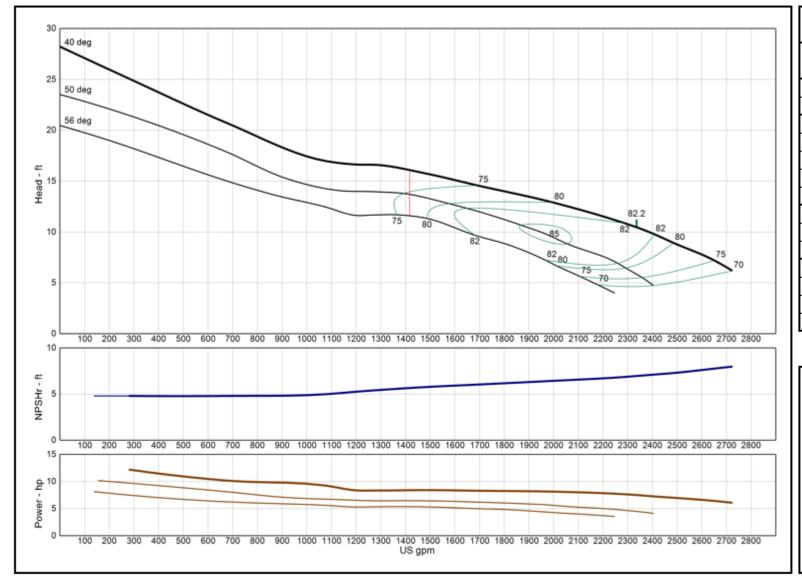

Model	12MMO	
RPM	885	
Freq Poles	60 Hz 8-pole	
Pump Type	Lineshaft	
EFFICIENCY	CORRECTION	
1-STAGE	0.0	
2-STAGE	0.0	
3-STAGE	0.0	
4-STAGE	0.0	
Impeller Type	Open	
Ns	7460	
Thrust K-Factor	0.00 lb/ft	
Bowl OD	0.00 in	
Bowl Lateral	0.00 in	
Max PSI	340 psi	
Thd Disch Size	12", 14"	
TURRING ORGANIONS		


TURBINE OPERATIONS

Lubbock, Texas







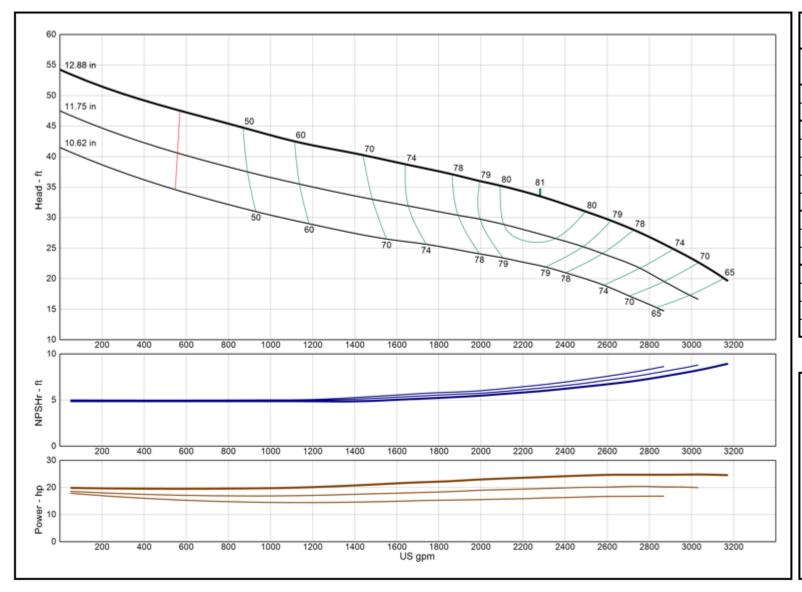


Model	18DXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3035
Thrust K-Factor	32.00 lb/ft
Bowl OD	17.75 in
Bowl Lateral	0.75 in
Max PSI	380 psi
Thd Disch Size	
TURRING ORGANIONS	

Lubbock, Texas







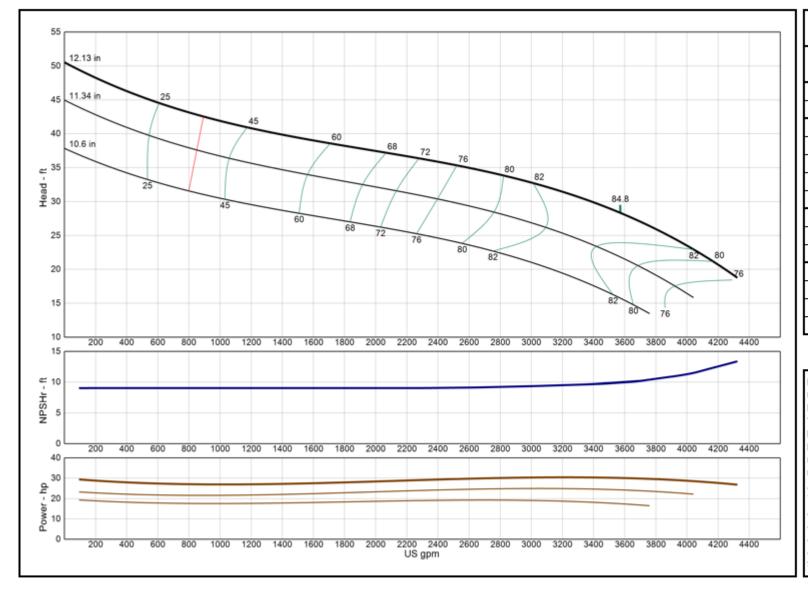

Model	18GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4305
Thrust K-Factor	39.50 lb/ft
Bowl OD	18.50 in
Bowl Lateral	1.14 in
Max PSI	410 psi
Thd Disch Size	


TURBINE OPERATIONS

Lubbock, Texas







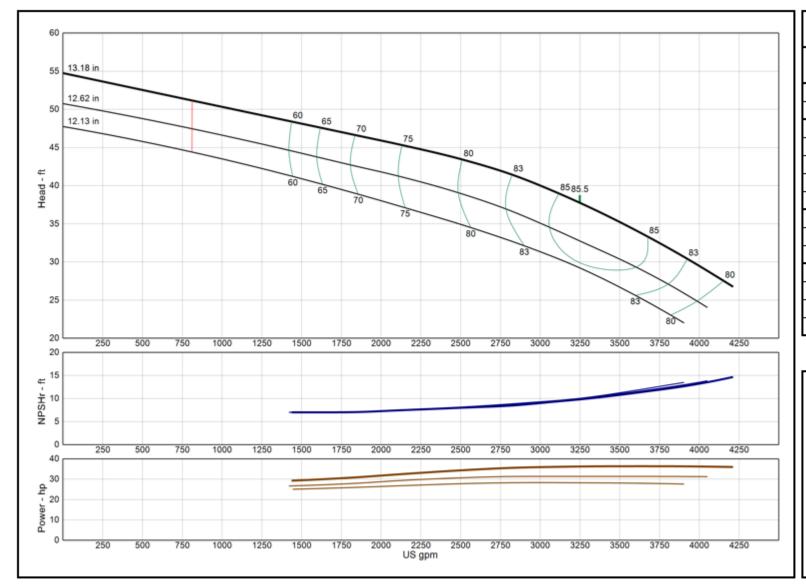

Model	20EHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3315
Thrust K-Factor	36.00 lb/ft
Bowl OD	18.94 in
Bowl Lateral	0.88 in
Max PSI	370 psi
Thd Disch Size	12", 14"


TURBINE OPERATIONS

Lubbock, Texas







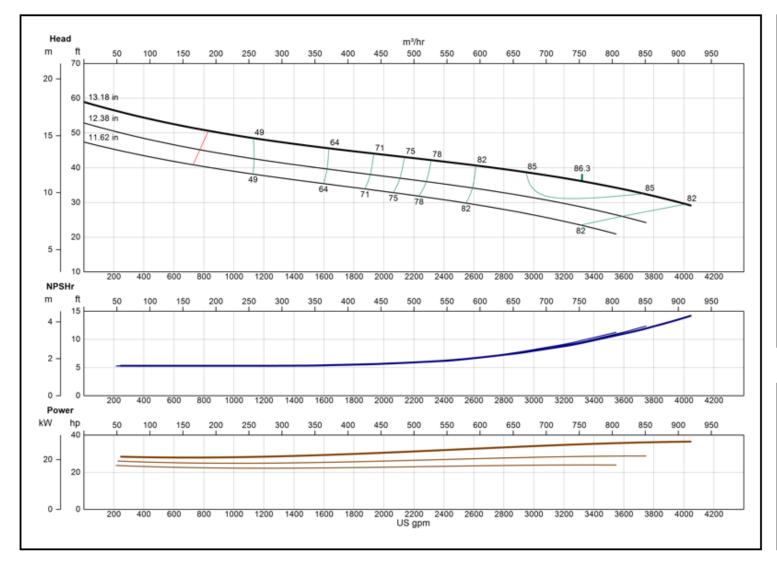

Model	20EHXC	
RPM	885	
Freq Poles	60 Hz 8-pole	
Pump Type	Lineshaft	
EFFICIENCY CORRECTION		
1-STAGE	0.0	
2-STAGE	0.0	
3-STAGE	0.0	
4-STAGE	0.0	
Impeller Type	Enclosed	
Ns	3340	
Thrust K-Factor	36.00 lb/ft	
Bowl OD	18.94 in	
Bowl Lateral	0.88 in	
Max PSI	370 psi	
Thd Disch Size	12", 14"	
VOLUME AND C		


XYLEM AWS

Lubbock, TX







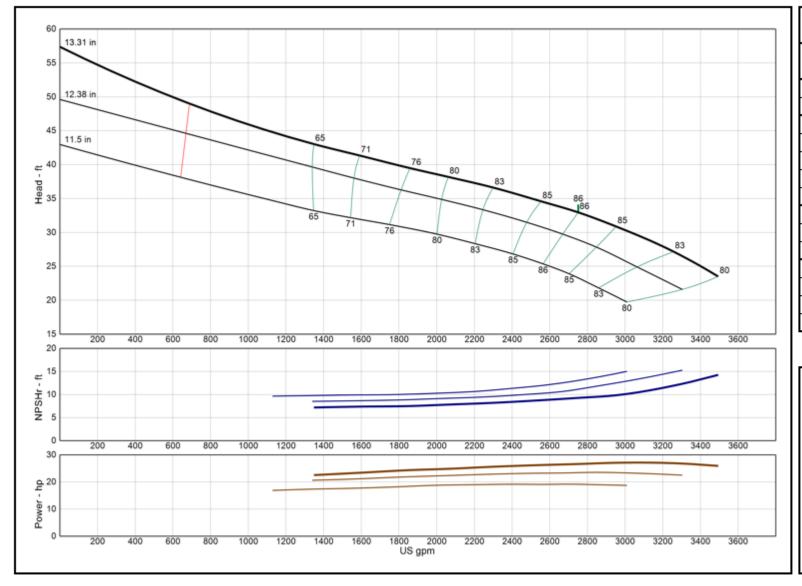

Model	20ELC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-3.0
2-STAGE	-1.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3375
Thrust K-Factor	31.00 lb/ft
Bowl OD	18.94 in
Bowl Lateral	0.88 in
Max PSI	370 psi
Thd Disch Size	12", 14"
TURRING ORER	ATIONIC


TURBINE OPERATIONS

Lubbock, Texas







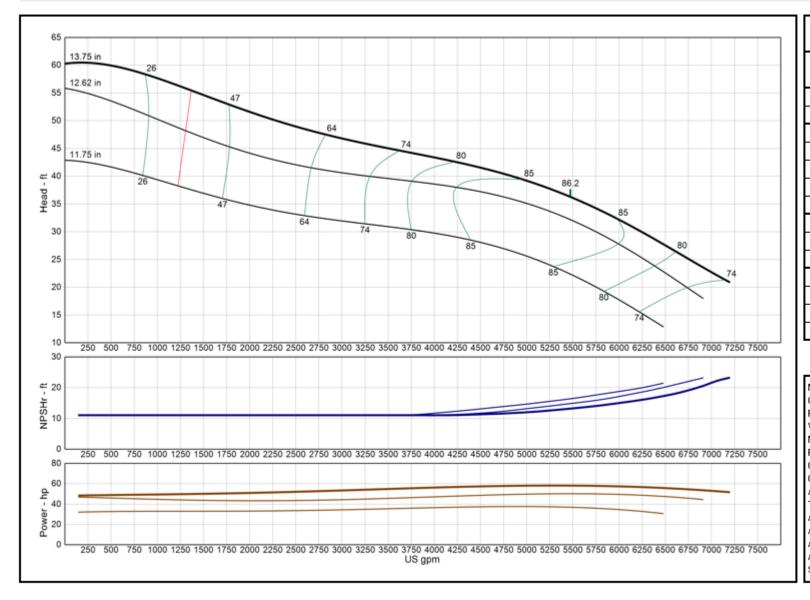


Model	20GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-4.0
2-STAGE	-3.0
3-STAGE	-2.0
4-STAGE	-1.0
Impeller Type	Enclosed
Ns	4430
Thrust K-Factor	41.20 lb/ft
Bowl OD	20.75 in
Bowl Lateral	1.41 in
Max PSI	270 psi
Thd Disch Size	
TURRING ORER	ATIONS

Lubbock, Texas







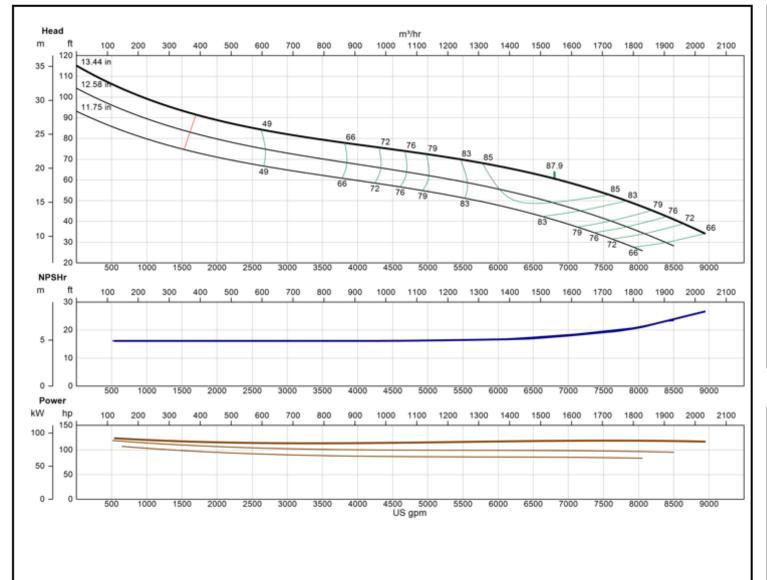

Model	20GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY (CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4240
Thrust K-Factor	52.00 lb/ft
Bowl OD	20.75 in
Bowl Lateral	1.41 in
Max PSI	270 psi
Thd Disch Size	
VOVI EM AVAIC	


XYLEM AWS

Lubbock, TX







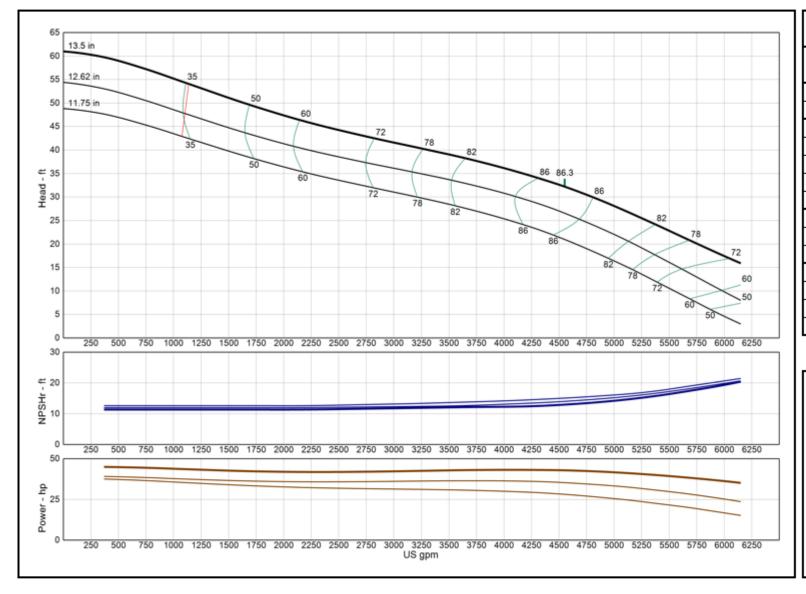


Model	20GLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4415
Thrust K-Factor	45.00 lb/ft
Bowl OD	20.75 in
Bowl Lateral	1.41 in
Max PSI	270 psi
Thd Disch Size	
TURRING ORGANIONS	

Lubbock, Texas







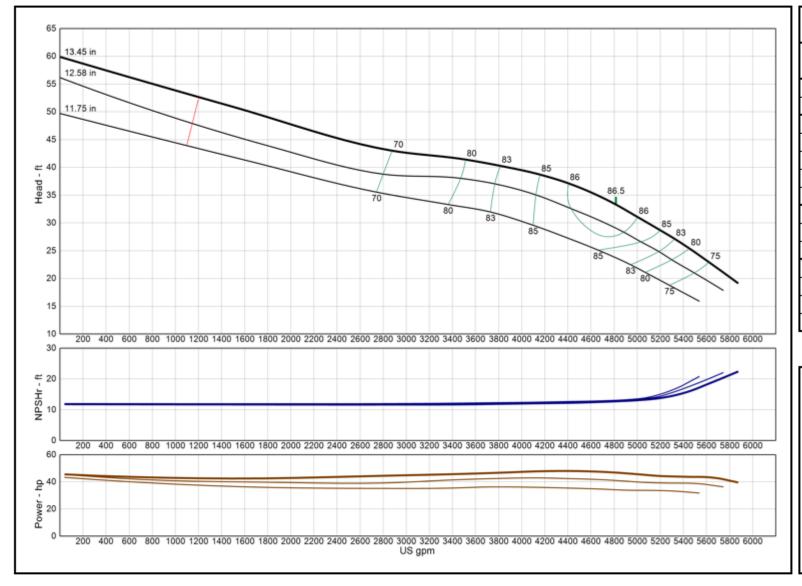

Model	20GLXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4430
Thrust K-Factor	55.40 lb/ft
Bowl OD	20.75 in
Bowl Lateral	1.41 in
Max PSI	270 psi
Thd Disch Size	
TUDRING ODERATIONS	

Lubbock, Texas








MODEL 20RCHC

(Effective July 17, 2019)

Vertical Turbine Pump

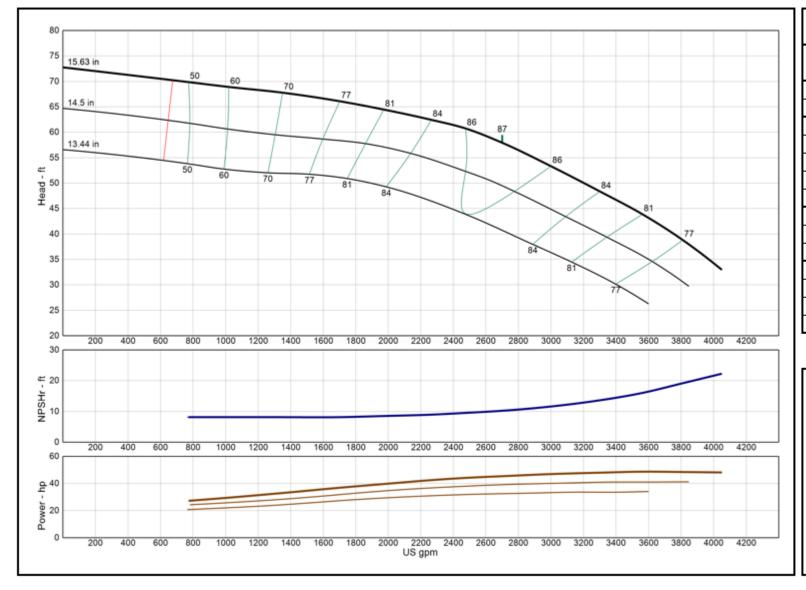

Model	20RCHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2190
Thrust K-Factor	24.00 lb/ft
Bowl OD	21.13 in
Bowl Lateral	1.12 in
Max PSI	400 psi
Thd Disch Size	


TURBINE OPERATIONS

Lubbock, Texas







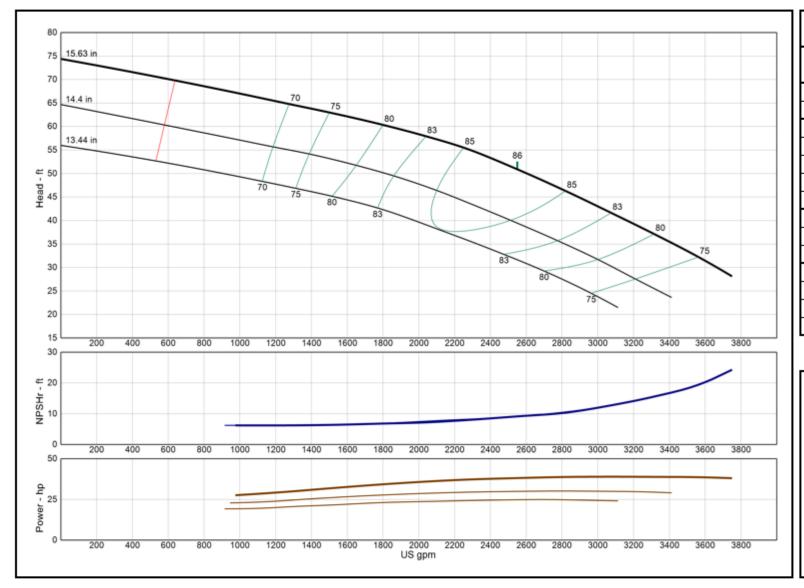


Model	20RCLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2345
Thrust K-Factor	24.00 lb/ft
Bowl OD	21.13 in
Bowl Lateral	1.12 in
Max PSI	400 psi
Thd Disch Size	
TURRING ORGANIONS	

Lubbock, Texas







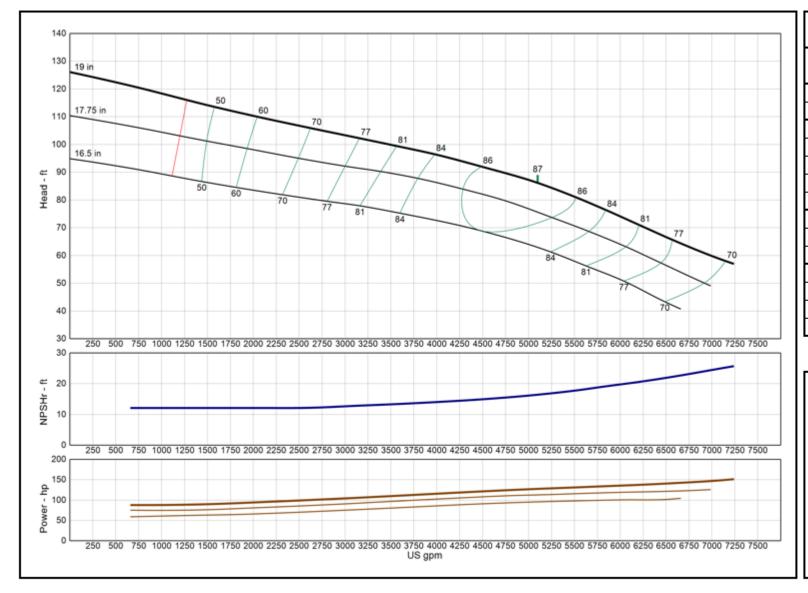


Model	24CHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.5
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2235
Thrust K-Factor	37.80 lb/ft
Bowl OD	25.00 in
Bowl Lateral	0.87 in
Max PSI	320 psi
Thd Disch Size	
TURRING ORGANIONS	

Lubbock, Texas







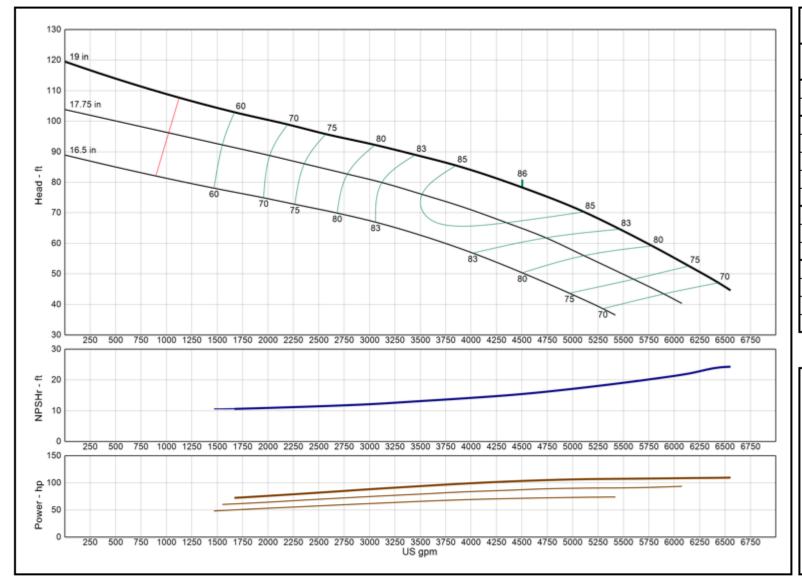

Model	24CLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.5
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2255
Thrust K-Factor	43.20 lb/ft
Bowl OD	25.00 in
Bowl Lateral	0.87 in
Max PSI	320 psi
Thd Disch Size	
TURRING ORGRATIONS	


TURBINE OPERATIONS

Lubbock, Texas







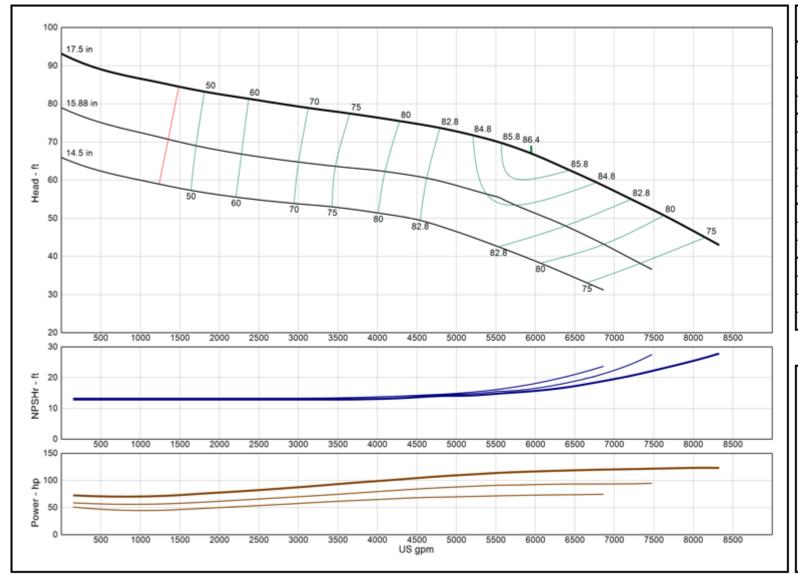

Model	24DMC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2915
Thrust K-Factor	39.50 lb/ft
Bowl OD	24.25 in
Bowl Lateral	1.12 in
Max PSI	390 psi
Thd Disch Size	


TURBINE OPERATIONS

Lubbock, Texas







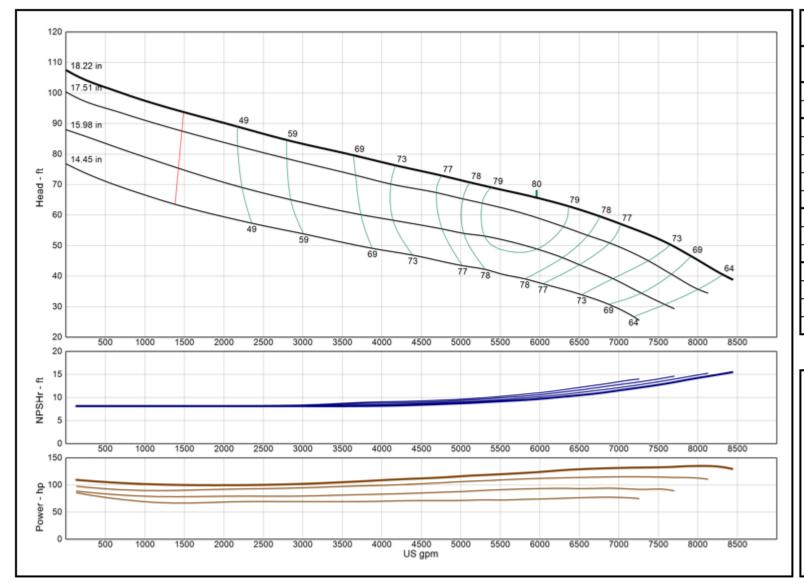

Model	24DXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2960
Thrust K-Factor	59.20 lb/ft
Bowl OD	24.50 in
Bowl Lateral	0.62 in
Max PSI	390 psi
Thd Disch Size	


TURBINE OPERATIONS

Lubbock, Texas







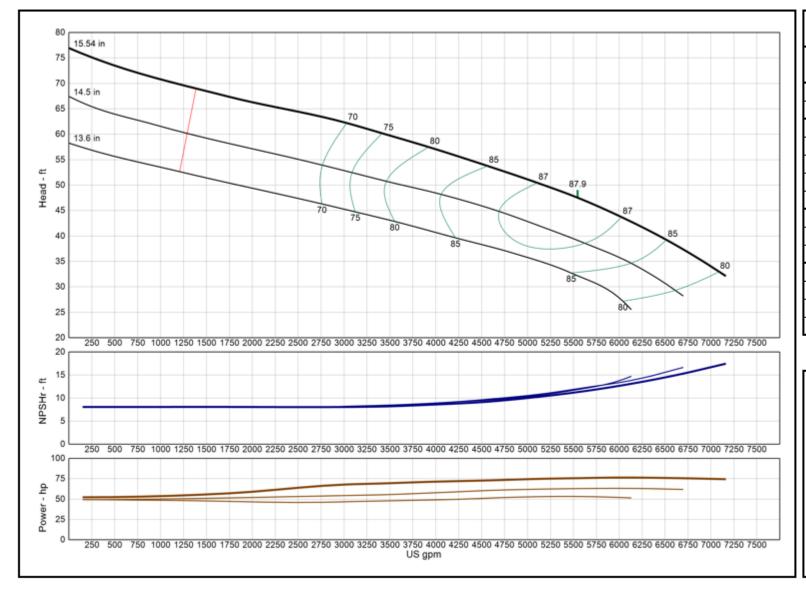


Model	24EHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3640
Thrust K-Factor	43.40 lb/ft
Bowl OD	22.25 in
Bowl Lateral	0.87 in
Max PSI	390 psi
Thd Disch Size	
TUDDING ODED	ATIONS

Lubbock, Texas







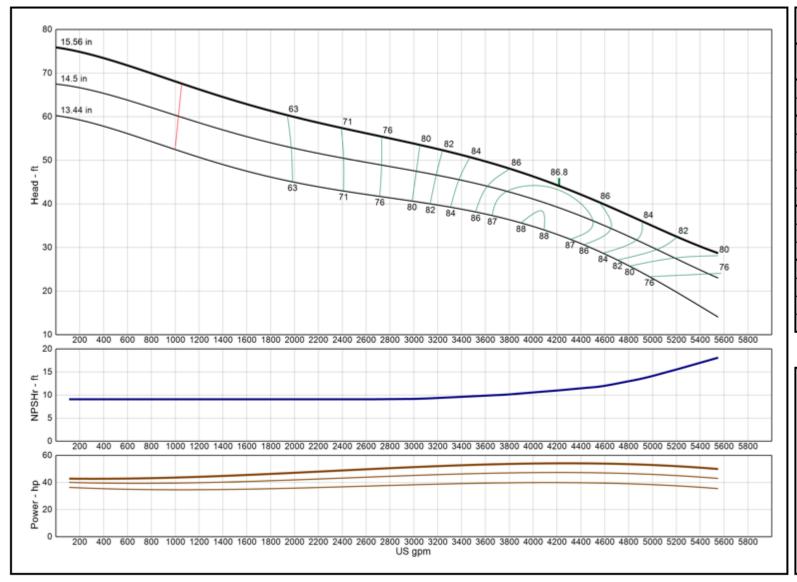


Model	24ELC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3355
Thrust K-Factor	42.00 lb/ft
Bowl OD	22.25 in
Bowl Lateral	0.87 in
Max PSI	390 psi
Thd Disch Size	
TURRING ORER	ATIONIC

Lubbock, Texas







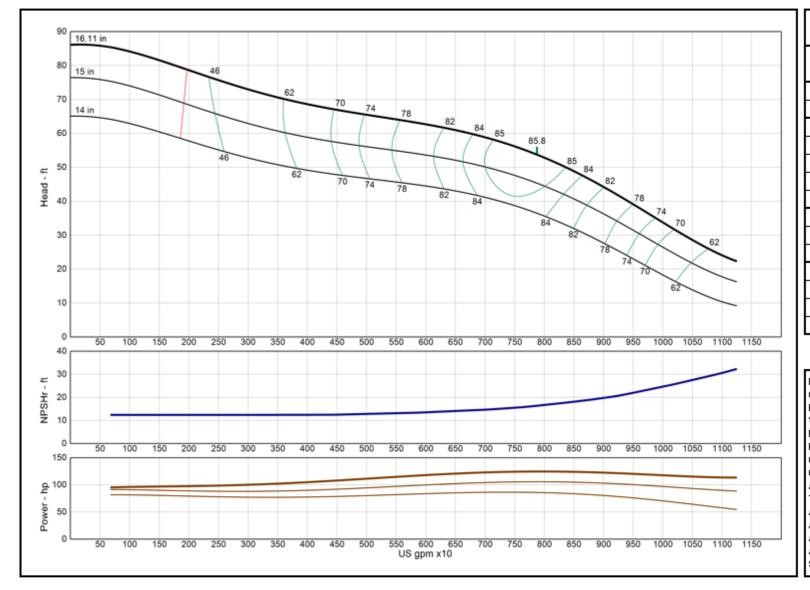

Model	24FHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3955
Thrust K-Factor	31.00 lb/ft
Bowl OD	24.13 in
Bowl Lateral	0.87 in
Max PSI	320 psi
Thd Disch Size	


TURBINE OPERATIONS

Lubbock, Texas







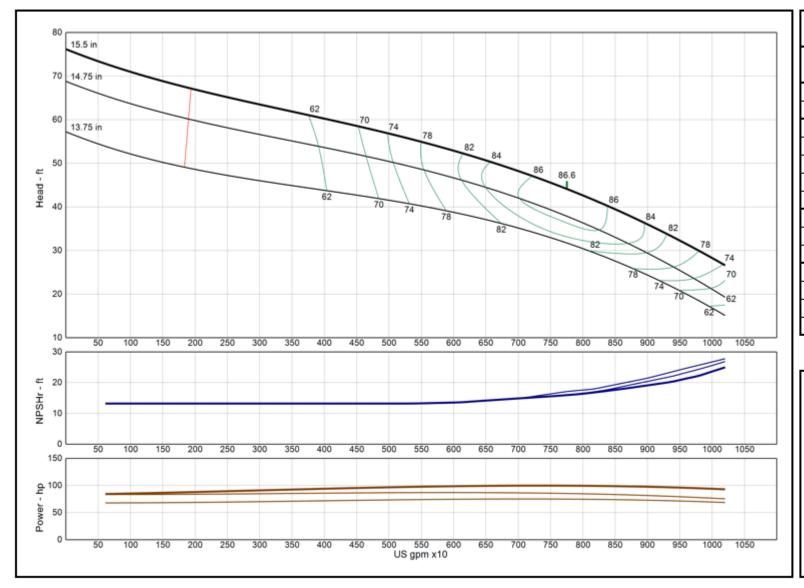


Model	24GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-4.0
2-STAGE	-3.0
3-STAGE	-2.0
4-STAGE	-1.0
Impeller Type	Enclosed
Ns	4550
Thrust K-Factor	60.00 lb/ft
Bowl OD	24.00 in
Bowl Lateral	1.62 in
Max PSI	350 psi
Thd Disch Size	
TUDRING ODERATIONS	

Lubbock, Texas







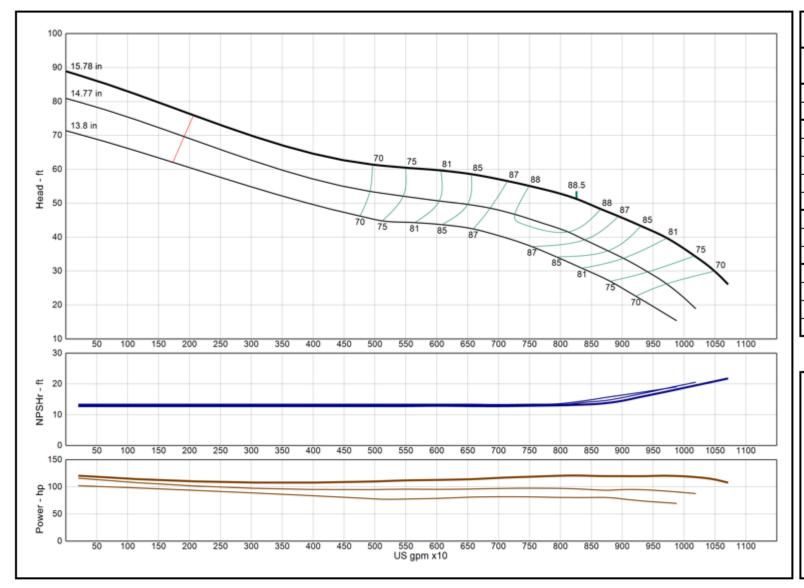

Model	24GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4200
Thrust K-Factor	68.70 lb/ft
Bowl OD	25.00 in
Bowl Lateral	1.62 in
Max PSI	350 psi
Thd Disch Size	
TURRING ORER	ATIONE


TURBINE OPERATIONS

Lubbock, Texas







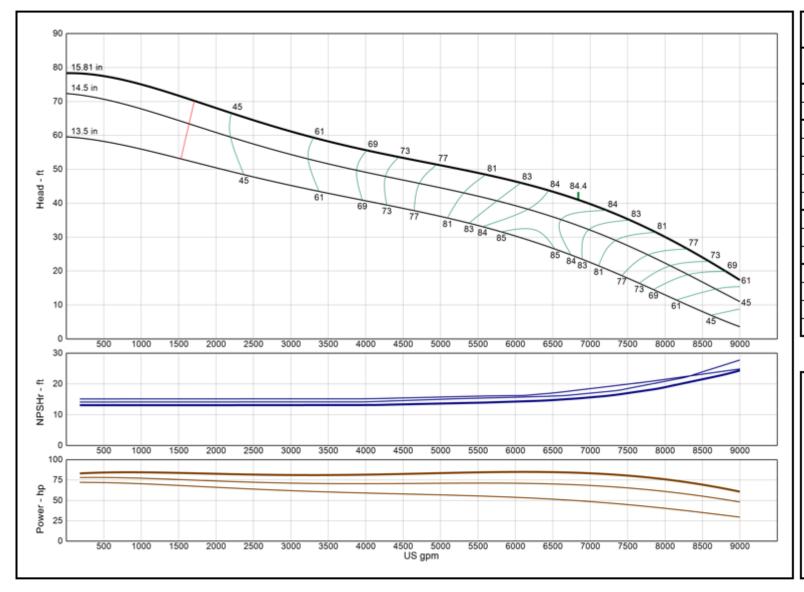

Model	24GLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4515
Thrust K-Factor	59.50 lb/ft
Bowl OD	24.00 in
Bowl Lateral	1.62 in
Max PSI	350 psi
Thd Disch Size	-
TUDDINE ODED	ATIONS


TURBINE OPERATIONS

Lubbock, Texas







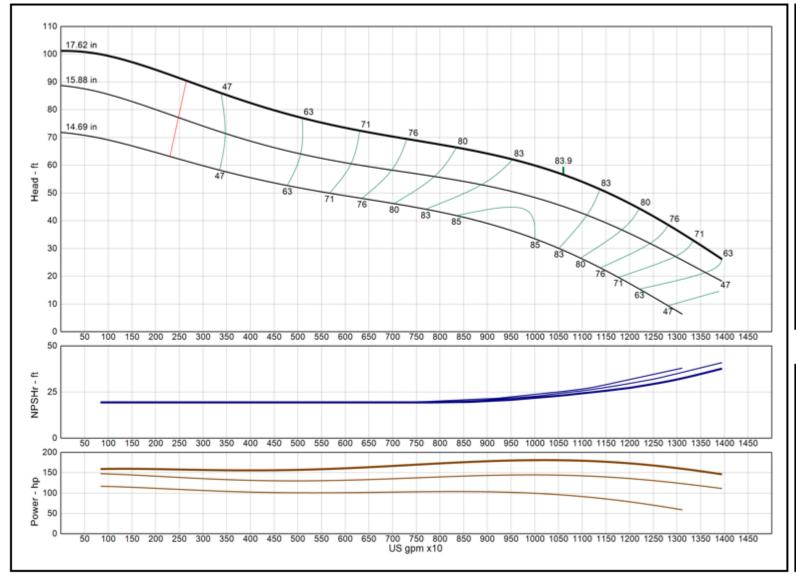


Model	26GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-4.0
2-STAGE	-3.0
3-STAGE	-2.0
4-STAGE	-1.0
Impeller Type	Enclosed
Ns	4415
Thrust K-Factor	64.20 lb/ft
Bowl OD	24.50 in
Bowl Lateral	1.00 in
Max PSI	330 psi
Thd Disch Size	
TUDDING ODED	ATIONIC

Lubbock, Texas







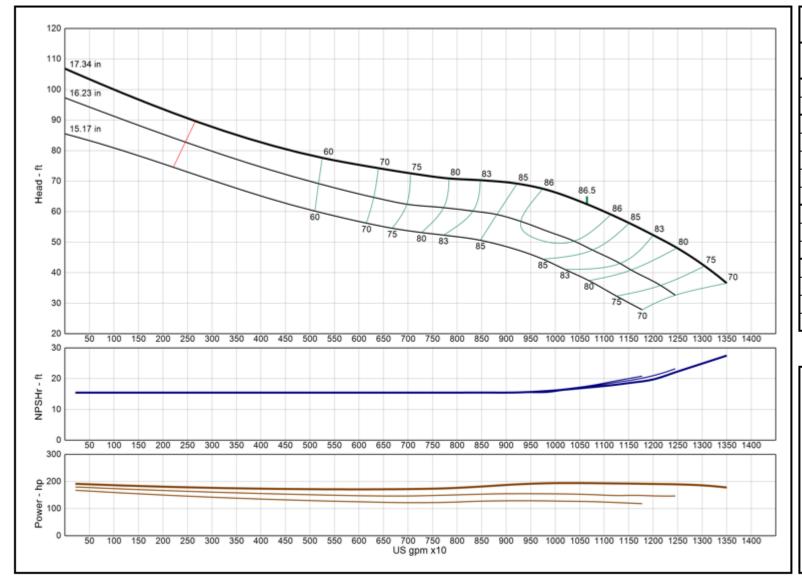

Model	26GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4110
Thrust K-Factor	80.90 lb/ft
Bowl OD	24.50 in
Bowl Lateral	1.00 in
Max PSI	330 psi
Thd Disch Size	
TURRING ORFR	ATIONIC


TURBINE OPERATIONS

Lubbock, Texas







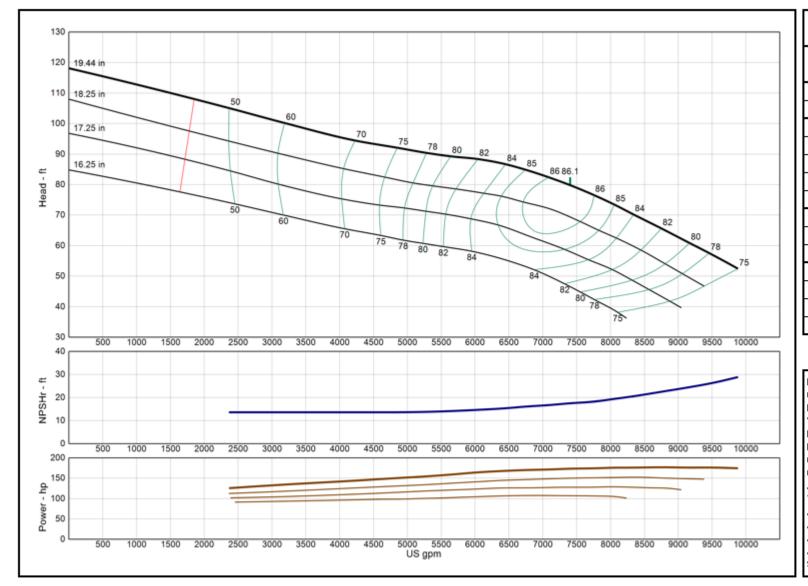

Model	28BHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2850
Thrust K-Factor	68.50 lb/ft
Bowl OD	26.88 in
Bowl Lateral	0.87 in
Max PSI	380 psi
Thd Disch Size	
	·


TURBINE OPERATIONS

Lubbock, Texas







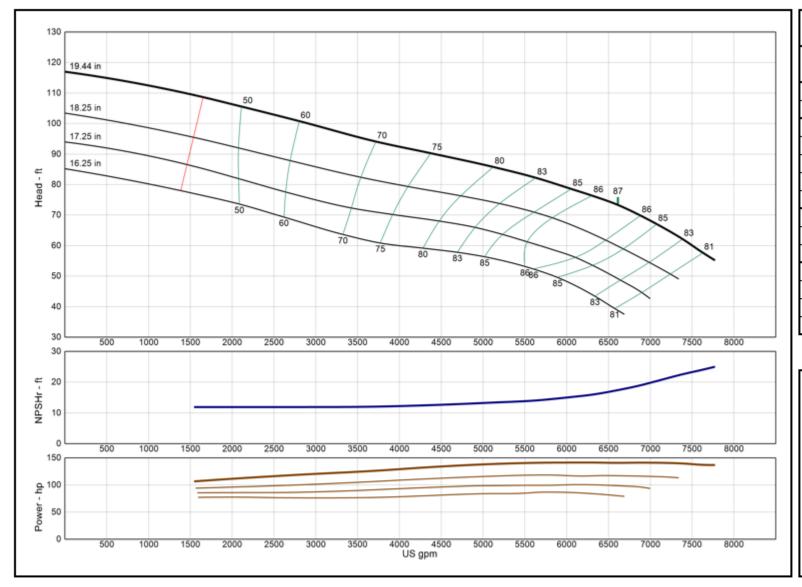


Model	28BLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-3.0
2-STAGE	-1.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	2870
Thrust K-Factor	68.50 lb/ft
Bowl OD	26.88 in
Bowl Lateral	0.87 in
Max PSI	380 psi
Thd Disch Size	-
TURRING OPERATIONS	

Lubbock, Texas







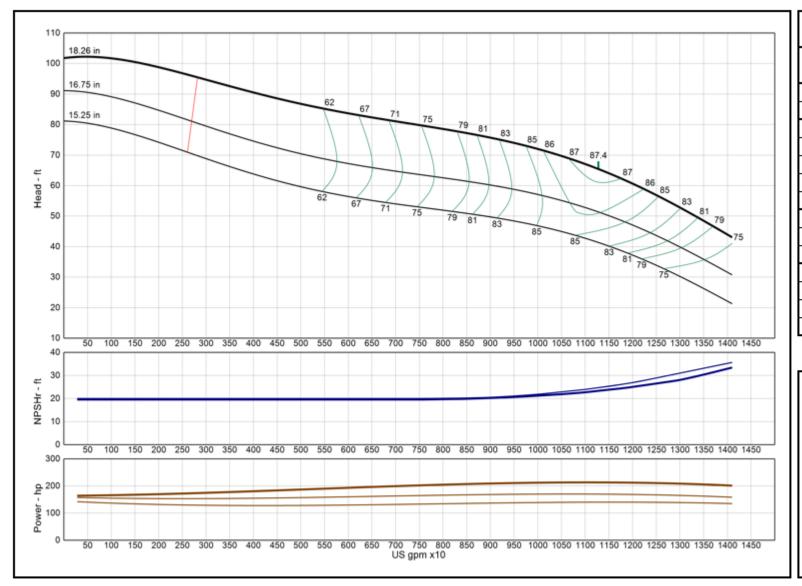


Model	28GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4085
Thrust K-Factor	69.00 lb/ft
Bowl OD	26.88 in
Bowl Lateral	1.50 in
Max PSI	320 psi
Thd Disch Size	-
TURRING ORER	ATIONIC

Lubbock, Texas







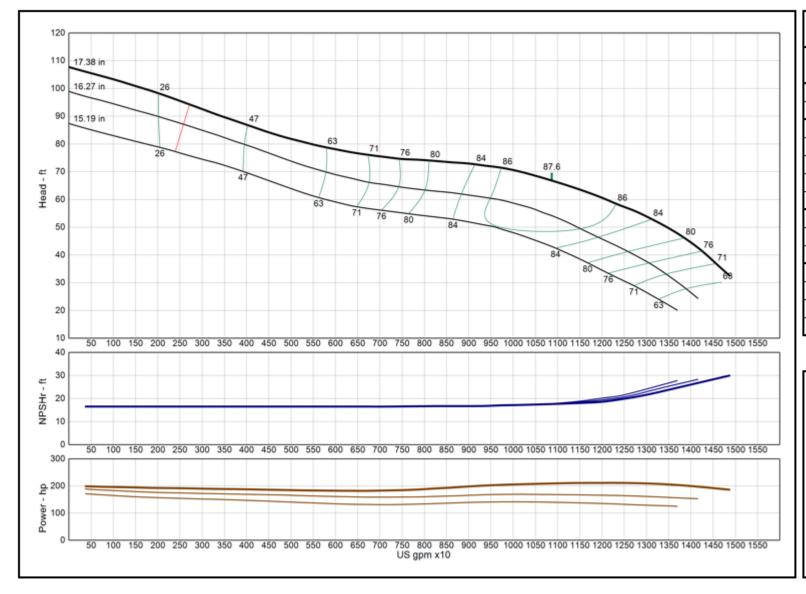

Model	28GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3945
Thrust K-Factor	86.90 lb/ft
Bowl OD	27.88 in
Bowl Lateral	1.13 in
Max PSI	320 psi
Thd Disch Size	
TURRING ORER	ATIONIC

TURBINE OPERATIONS

Lubbock, Texas








MODEL 30BHC

(Effective July 17, 2019)

Vertical Turbine Pump

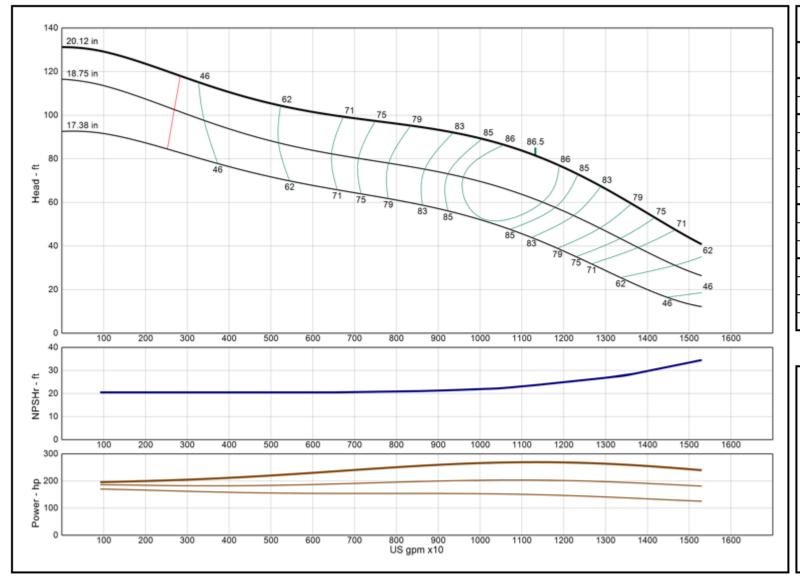

Model	30ВНС
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3470
Thrust K-Factor	92.00 lb/ft
Bowl OD	29.50 in
Bowl Lateral	0.87 in
Max PSI	380 psi
Thd Disch Size	
TURRING ORGANIONS	

TURBINE OPERATIONS


Lubbock, Texas







Vertical Turbine Pump

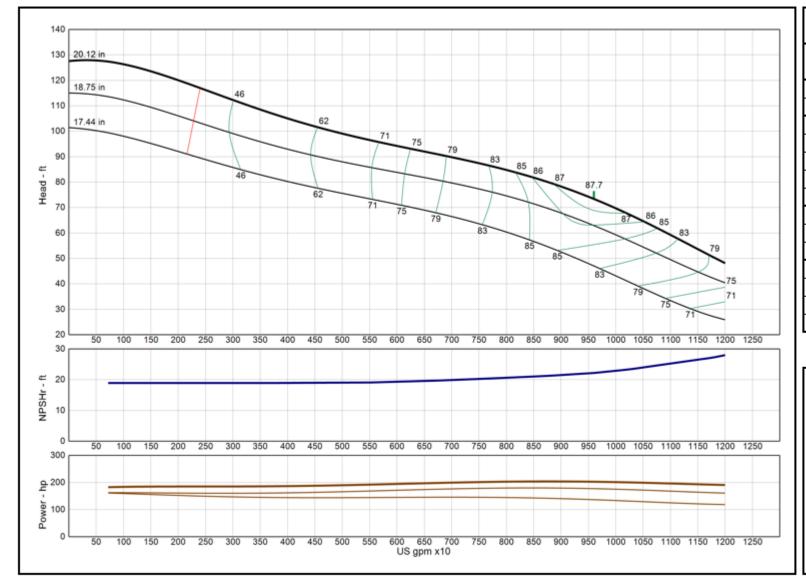

Model	30BLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	-1.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3460
Thrust K-Factor	92.00 lb/ft
Bowl OD	29.50 in
Bowl Lateral	0.87 in
Max PSI	380 psi
Thd Disch Size	-
TURBULE ORERATIONS	

TURBINE OPERATIONS

Lubbock, Texas








MODEL 30GHC

(Effective November 04, 2019)

Vertical Turbine Pump

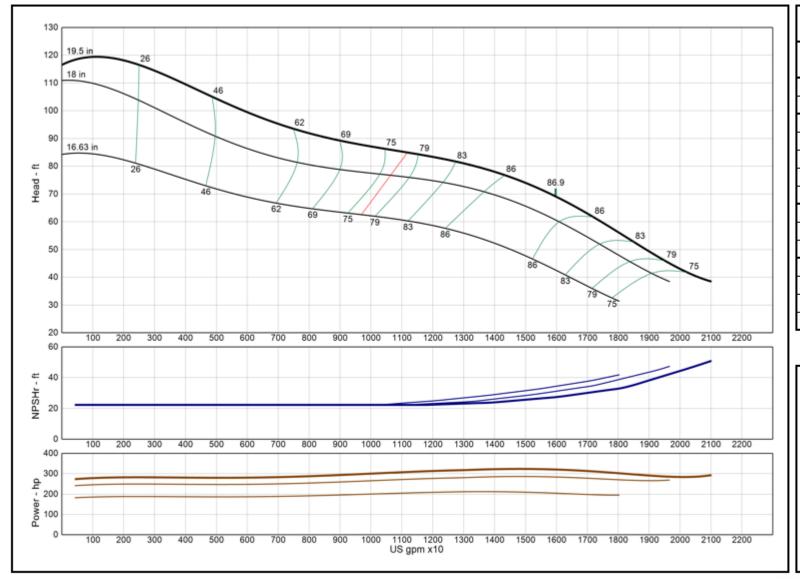

Model	30GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4665
Thrust K-Factor	104.90 lb/ft
Bowl OD	30.00 in
Bowl Lateral	2.32 in
Max PSI	320 psi
Thd Disch Size	
TURBULE ORERATIONS	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 30GHXC

(Effective November 04, 2019)

Vertical Turbine Pump

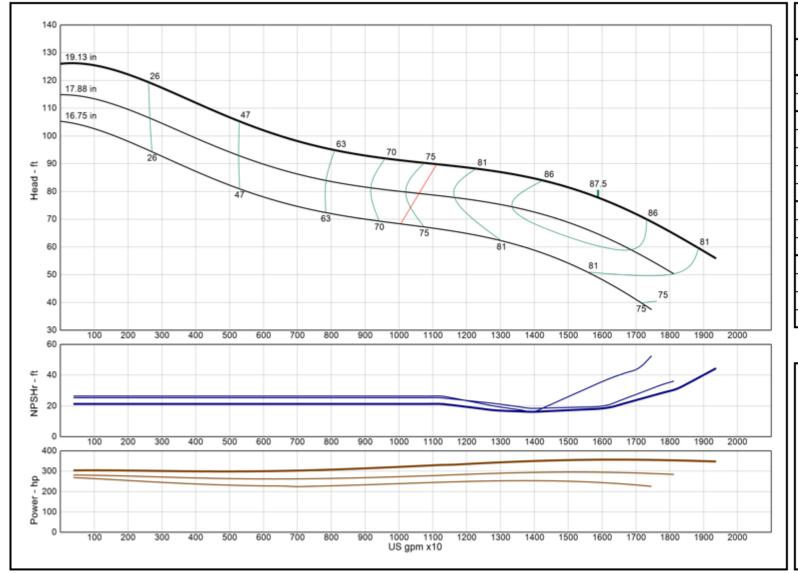

Model	30GНХС
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4255
Thrust K-Factor	125.20 lb/ft
Bowl OD	30.00 in
Bowl Lateral	2.32 in
Max PSI	320 psi
Thd Disch Size	
TURBULE ORER	ATIONIC

TURBINE OPERATIONS


Lubbock, Texas



MODEL 30GLC

(Effective November 04, 2019)

Vertical Turbine Pump

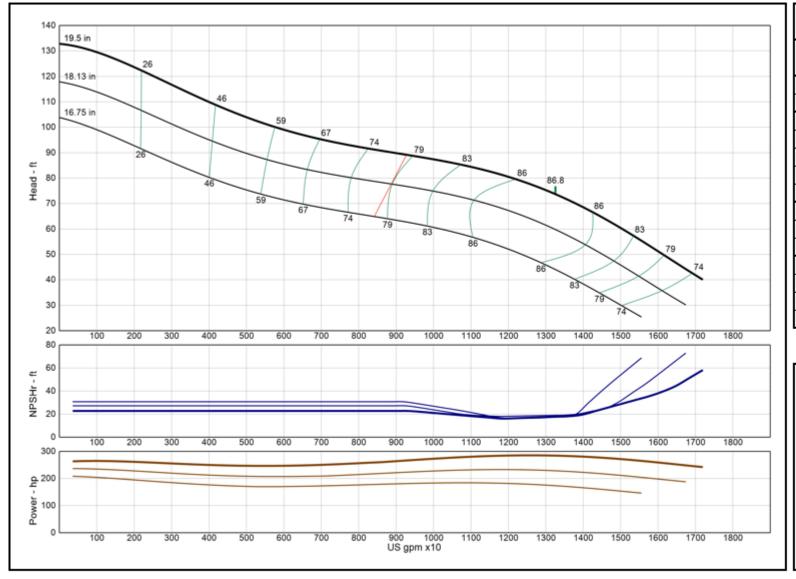

Model	30GLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4050
Thrust K-Factor	103.60 lb/ft
Bowl OD	30.00 in
Bowl Lateral	2.32 in
Max PSI	320 psi
Thd Disch Size	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 32GHC

(Effective November 04, 2019)

Vertical Turbine Pump

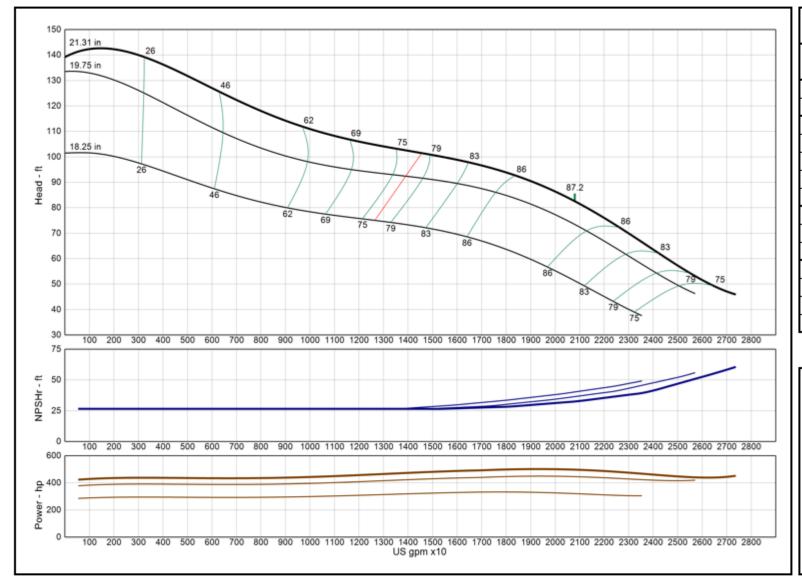

Model	32GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4660
Thrust K-Factor	124.40 lb/ft
Bowl OD	32.00 in
Bowl Lateral	2.25 in
Max PSI	320 psi
Thd Disch Size	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 32GHXC

(Effective November 04, 2019)

Vertical Turbine Pump

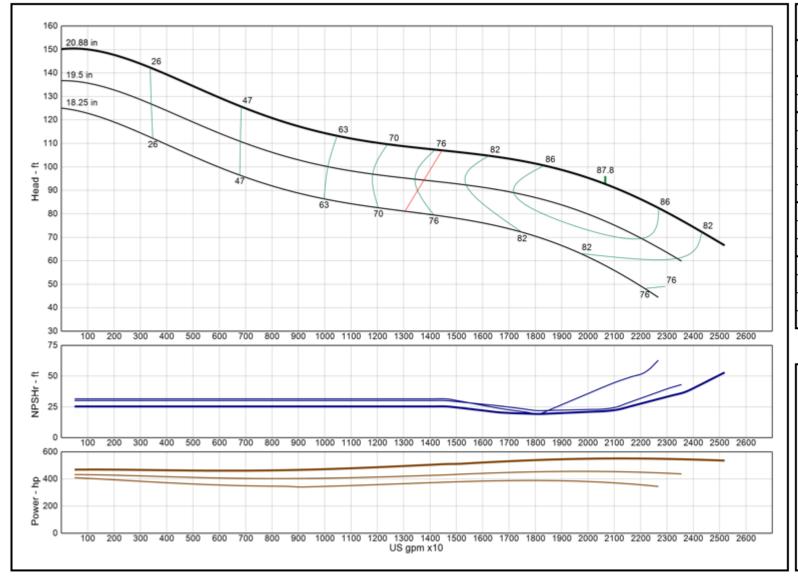

Model	32GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4255
Thrust K-Factor	148.10 lb/ft
Bowl OD	32.00 in
Bowl Lateral	2.25 in
Max PSI	320 psi
Thd Disch Size	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 32GLC

(Effective November 04, 2019)

Vertical Turbine Pump

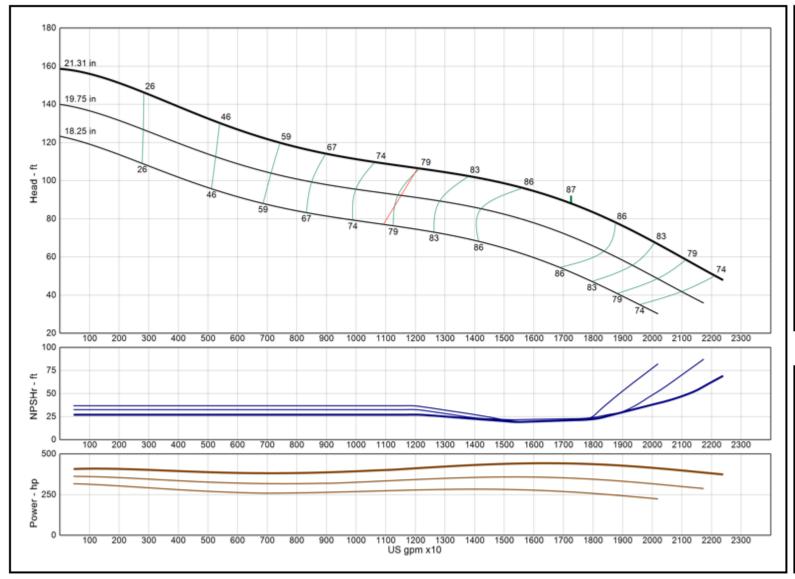

Model	32GLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4045
Thrust K-Factor	121.40 lb/ft
Bowl OD	32.00 in
Bowl Lateral	2.25 in
Max PSI	320 psi
Thd Disch Size	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 34GHC

(Effective November 04, 2019)

Vertical Turbine Pump

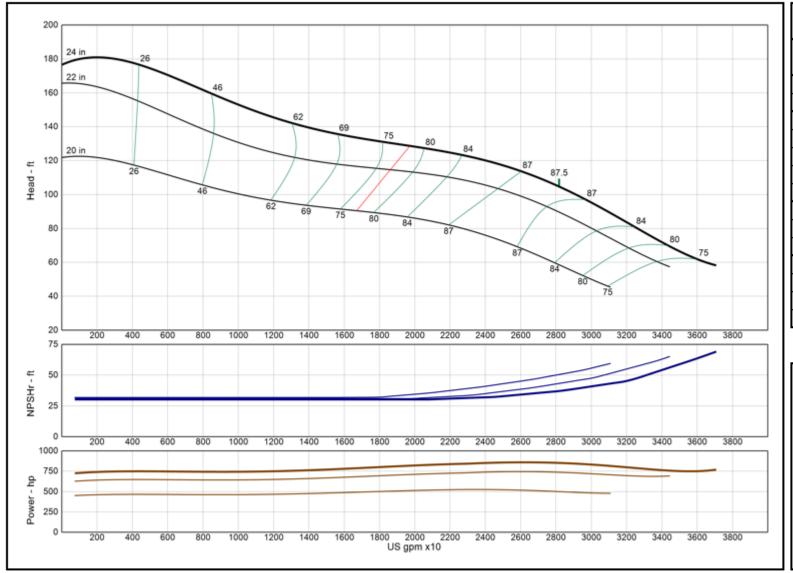

Model	34GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4540
Thrust K-Factor	151.00 lb/ft
Bowl OD	34.00 in
Bowl Lateral	2.11 in
Max PSI	330 psi
Thd Disch Size	
	·

TURBINE OPERATIONS


Lubbock, Texas



MODEL 34GHXC

(Effective November 04, 2019)

Vertical Turbine Pump

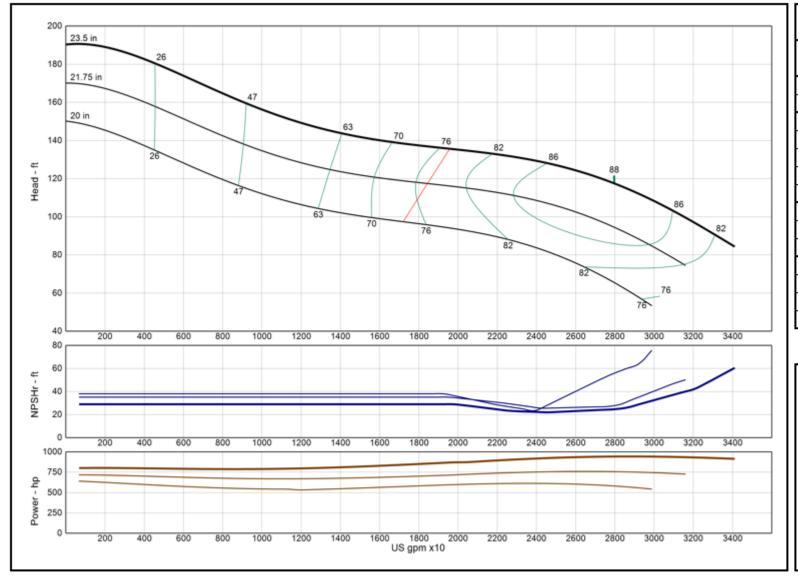

Model	34GHXC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4145
Thrust K-Factor	177.50 lb/ft
Bowl OD	34.00 in
Bowl Lateral	2.11 in
Max PSI	330 psi
Thd Disch Size	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 34GLC

(Effective November 04, 2019)

Vertical Turbine Pump

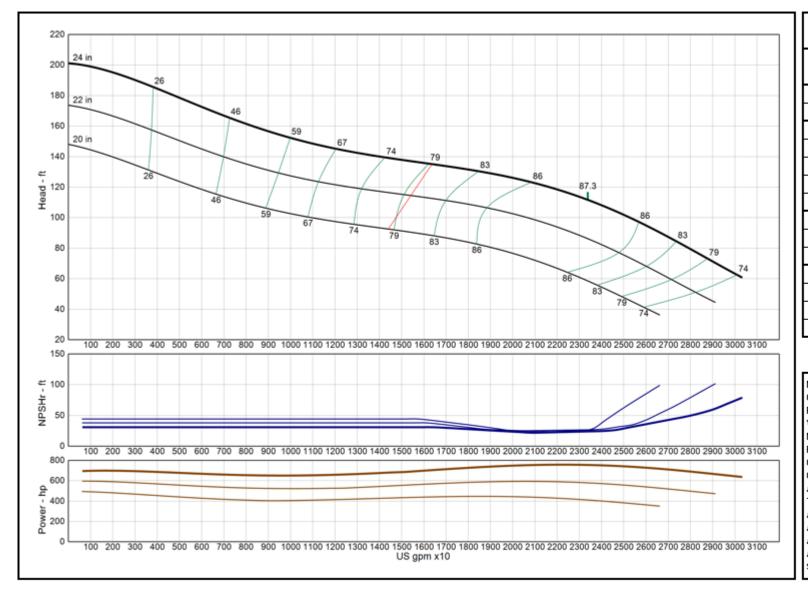

Model	34GLC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	3940
Thrust K-Factor	147.20 lb/ft
Bowl OD	34.00 in
Bowl Lateral	2.11 in
Max PSI	330 psi
Thd Disch Size	

TURBINE OPERATIONS


Lubbock, Texas



MODEL 36GHC

(Effective November 04, 2019)

Vertical Turbine Pump

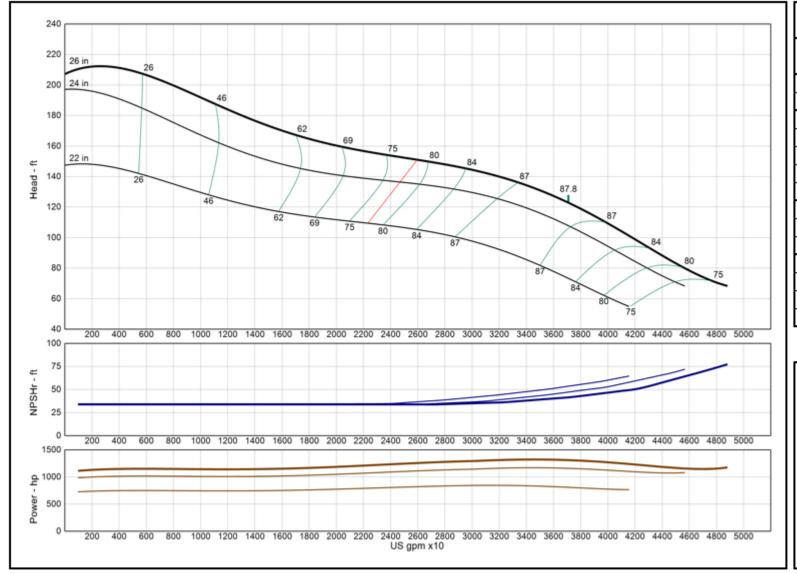

Model	36GHC
RPM	885
Freq Poles	60 Hz 8-pole
Pump Type	Lineshaft
EFFICIENCY	CORRECTION
1-STAGE	0.0
2-STAGE	0.0
3-STAGE	0.0
4-STAGE	0.0
Impeller Type	Enclosed
Ns	4620
Thrust K-Factor	179.40 lb/ft
Bowl OD	36.00 in
Bowl Lateral	2.80 in
Max PSI	270 psi
Thd Disch Size	
TURBUNE ORFR	TIONE

TURBINE OPERATIONS


Lubbock, Texas



MODEL 36GHXC

(Effective November 04, 2019)

Vertical Turbine Pump

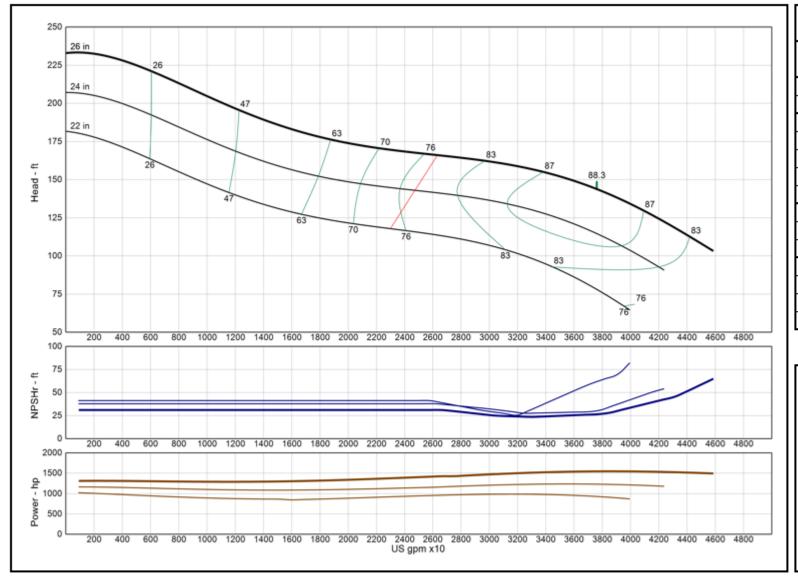

Model	36GHXC			
RPM	885			
Freq Poles	60 Hz 8-pole			
Pump Type	Lineshaft			
EFFICIENCY CORRECTION				
1-STAGE	0.0			
2-STAGE	0.0			
3-STAGE	0.0			
4-STAGE	0.0			
Impeller Type	Enclosed			
Ns	4130			
Thrust K-Factor	212.00 lb/ft			
Bowl OD	36.00 in			
Bowl Lateral	2.80 in			
Max PSI	270 psi			
Thd Disch Size				

TURBINE OPERATIONS


Lubbock, Texas



MODEL 36GLC

(Effective November 04, 2019)

Vertical Turbine Pump

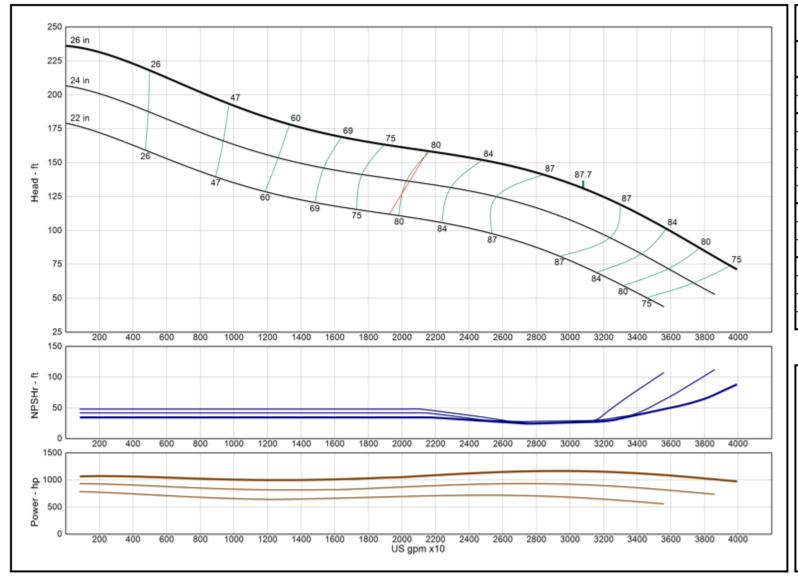

Model	36GLC			
RPM	885			
Freq Poles	60 Hz 8-pole			
Pump Type	Lineshaft			
EFFICIENCY CORRECTION				
1-STAGE	0.0			
2-STAGE	0.0			
3-STAGE	0.0			
4-STAGE	0.0			
Impeller Type	Enclosed			
Ns	4010			
Thrust K-Factor	175.10 lb/ft			
Bowl OD	36.00 in			
Bowl Lateral	2.80 in			
Max PSI	270 psi			
Thd Disch Size				

TURBINE OPERATIONS

Lubbock, Texas



Xylem |'zīləm|

- 1) The tissue in plants that brings water upward from the roots;
- 2) a leading global water technology company.

We're a global team unified in a common purpose: creating advanced technology solutions to the world's water challenges. Developing new technologies that will improve the way water is used, conserved, and re-used in the future is central to our work. Our products and services move, treat, analyze, monitor and return water to the environment, in public utility, industrial, residential and commercial building services settings. Xylem also provides a leading portfolio of smart metering, network technologies and advanced analytics solutions for water, electric and gas utilities. In more than 150 countries, we have strong, long-standing relationships with customers who know us for our powerful combination of leading product brands and applications expertise with a strong focus on developing comprehensive, sustainable solutions.

For more information on how Xylem can help you, go to www.xylem.com

To learn more about turbine pumps:





Xylem Inc. P.O. Box 5487 Lubbock, TX 79408 Tel +1.806.763.7867 Fax +1.800.453.4749 www.xylem.com

Xylem and Bell & Gossett are trademarks of Xylem Inc. or one of its subsidiaries. Goulds is a registered trademark of Goulds Pumps, Inc. and is used under license. All other trademarks or registered trademarks are property of their respective owners. © 2024 Xylem Inc. C900 R7 May 2024